

# Transfero TVI Connect



**Pressure maintenance system with pumps and integrated *cyclonic vacuum degassing***

For higher pressures in heating systems up to 8 MW and cooling systems up to 13 MW

# Transfero TVI Connect

The Transfero TVI Connect is a precision pressure maintenance device for higher pressures in heating and solar systems up to 8 MW, and chilled water systems up to 13 MW. Its use is particularly recommended where high performance, compact design and precision are required. The new **BrainCube Connect** control panel allows a new level of connectivity, enabling communication with the BMS system and other BrainCubes, as well as remote operation of the pressurisation system through live viewing.

## Key features

- > **2 in 1**  
The only pressurisation unit with integrated *cyclonic* vacuum degassing
- > **Higher Efficiency Cyclonic vacuum degassing**  
At least 50% higher efficiency than most other vacuum degassing systems.
- > **Easy Commissioning, Remote Access and Trouble-shooting**  
Automatic calibration and integrated standard connections to our IMI Webserver and to BMS.



## Technical description – Control unit TecBox

### Applications:

Heating, solar and chilled water systems. For systems according to EN 12828, SWKI HE301-01, solar systems according to EN 12976, ENV 12977 with on-site excess temperature protection in case of power outage.

### Media:

Non-aggressive and non-toxic system media.  
Ethylene or propylene glycol-based antifreeze up to 50%.

### Pressure:

Min. admissible pressure, PSmin: -1 bar  
Max. admissible pressure, PS: 25 bar

### Temperature:

Max. admissible temperature, TS: 90°C  
Min. admissible temperature, TSmmin: 0°C  
Max. admissible ambient temperature, TA: 40°C  
Min. admissible ambient temperature, TAMin: 5°C

### Accuracy:

Precision pressure maintenance  $\pm 0,2$  bar.

### Supply voltage:

Main voltage: 3x400V ( $\pm 10\%$ ) / 50Hz (3P+PE)  
Control voltage: 230V ( $\pm 10\%$ ) / 50Hz (P+N+PE)

### Electrical connections:

Onsite fuses according to power demand and local norms  
4 potential free outputs (NO) for external alarm indication (230V max. 2A)  
1 RS 485 In/Output  
1 Ethernet RJ45 plug socket  
1 USB Hub plug socket  
Terminal strip in PowerCube for direct wiring

### Enclosure class:

IP54 according to EN 60529

### Mechanical connections:

Sin1/Sin2: inlet from the system G3/4"  
Sout: outlet to the system G3/4"  
Swm: inlet water make-up G3/4"  
Sv: connection of the vessel G1 1/4"

### Material:

Metal components with medium contact: carbon steel, cast iron, stainless steel, AMETAL®, brass, gun metal.

### Transportation and storage:

In frostless, dry places.

### Standard:

Constructed according to  
LV-D. 2014/35/EU  
EMC-D. 2014/30/EU

## Technical description – Expansion vessels

### Applications:

Only together with TecBox Control Unit.

See *Applications* under Technical description - TecBox Control Unit.

### Media:

Non-aggressive and non-toxic system media.  
Addition of antifreeze agent up to 50%.

### Pressure:

Min. admissible pressure, PSmin: 0 bar  
Max. admissible pressure, PS: 2 bar

### Temperature:

Max. admissible bag temperature, TB: 70°C  
Min. admissible bag temperature, TBmin: 5°C

For PED purposes:

Max. admissible temperature, TS: 120°C  
Min. admissible temperature, TSmin: -10°C

### Material:

Steel. Color beryllium.

Airproof butyl bag according to EN 13831.

### Transportation and storage:

In frostless, dry places.

### Standard:

Constructed according to PED 2014/68/EU.

### Warranty:

Transfero TU, TU...E: 5-year warranty for the vessel.  
Transfero TG, TG...E: 5-year warranty for the airproof butyl bag.

## Function, Equipment, Features

### Control unit BrainCube Connect

- BrainCube Connect control for an intelligent, fully automatic, safe system operation. Self-optimising with memory function.
- Resistive 3.5" TFT illuminated colour touch display. Web-based interface with remote control and live view. User-friendly, operation-orientated menu layout with slide and tap operation, step-by-step start up procedure guide and direct help in pop-up windows. Representation of all relevant parameters and operation status in plain text and/or graphical, multilingual.
- Standardised integrated connections (Ethernet, RS 485) to the IMI webserver and BMS (Modbus and IMI Pneumatex protocol).
- Software updates and data logging possible via USB connection
- Data logging and system analysis, chronological message memory with prioritisation, remotely controllable with live view, periodical automatic self-test.
- High quality metal cover.
- Variable installation next to the primary vessel.

### Pressure maintenance

- Dynaflex operation.
- Protected isolating valves to the system. 2 bar safety valve and ball valve for fast draining of primary vessel
- Precision pressure maintenance ±0.2bar

### Vacuum Degassing

- About 1000 l/h flow capacity for system degassing.
- Vacusplit: Degassing programs for permanent operation with cyclonic technology. Gas under saturation of system water of nearly 100%. Eco automatic operation when no air is detected, savings on electricity consumption of the pump.
- Oxystop degassing: Direct degassing of make-up water. Significant oxygen reduction in the make-up water. Safely degasses both system and make-up water in a specially designed cyclone vessel (inside the Tecbox), with the advantage of low keeping temperature of the expansion vessel, without the need to insulate the vessel. Protects the system against corrosion.

### Water make-up

- Fillsafe: water-make up monitoring and control with integrated contact water flow meter and solenoid valve.
- Connection for optional Pleno P BA4R/AB5(R) water make-up devices for tap water protection following EN 1717.
- Softsafe monitoring and control for an optional refill water treatment device.

### Expansion vessels

- Bag can be vented at the top, condensate drain at the bottom.
- Sinus ring for upright assembly (TU, TU...E). Feet for upright assembly (TG, TG...E).
- Corrosion-protected internal coating for minimum bag wear (TG, TG...E).
- Airproof butyl bag (TU, TU...E, TG, TG...E), exchangeable (TG, TG...E).
- Endoscopic inspection opening for internal inspections (TU, TU...E). Two flange openings for internal inspections (TG, TG...E).

## Calculation

### Pressure maintenance for systems TAZ ≤ 100°C

Calculation following EN 12828, SWKI HE301-01 \*).

For all special applications such as solar systems, district heating systems, systems with temperatures above 100°C or cooling systems with temperatures below 5°C please use HySelect software or contact us.

#### General equations

|            |  |  |   |  |   |
|------------|--|--|---|--|---|
| <b>Vs</b>  | Water capacity of the system   | Heating                                    | <b>Vs = vs · Q</b>                                | vs<br>Q                                      | Specific water capacity, table 4<br>Installed heat capacity   |
|            |  |  | Vs= Known   |  | System design, content calculation  |
|            |  | Cooling                                    | Vs= Known   |  | System design, content calculation  |
| <b>Ve</b>  | Expansion volume   | EN 12828                                   | <b>Ve = e · (Vs+Vhs)</b>                          | e, ehs                                       | Expansion coefficient for $ts_{max}$ , table 1  |
|            |  | Cooling                                    | $Ve = e \cdot (Vs+Vhs)$                           | e, ehs                                       | Expansion coefficient for $ts_{max}$ , table 1 <sup>7)</sup>  |
|            |  | SWKI HE301-01 heating                      | $Ve = e \cdot Vs \cdot X^{1)} + ehs \cdot Vhs$    | e<br>ehs                                     | Expansion coefficient for $(ts_{max} + tr)/2$ , table 1<br>Expansion coefficient for $ts_{max}$ , table 1 |
|            |  | SWKI HE301-01 cooling                      | $Ve = e \cdot Vs \cdot X^{1)} + ehs \cdot Vhs$    | e, ehs                                       | Expansion coefficient for $ts_{max}$ , table 1 <sup>7)</sup>  |
| <b>Vwr</b> | Water reserve  | EN 12828, cooling                          | <b>Vwr ≥ 0,005 · Vs ≥ 3 L</b>                     |  |   |
|            |  | SWKI HE301-01                              | Vwr is considered in Ve with the coefficient X    |  |   |
| <b>p0</b>  | Minimum pressure <sup>2)</sup><br>Lower limit value for the pressure maintenance | EN 12828, cooling                          | <b>p0 = Hst/10 + 0,2 bar ≥ pz</b>                 | Hst<br>pz                                    | Static height<br>Minimum required equipment pressure for pumps or boilers                                 |
|            |  | SWKI HE301-01                              | $p0 = Hst/10 + 0,3 \text{ bar} \geq pz$           |  |   |
| <b>pa</b>  | Initial pressure<br>Lower threshold for an optimum pressure maintenance          |  | <b>pa ≥ p0 + 0,3 bar</b>                          |  |   |
| <b>pe</b>  | Final pressure   |  |   | psvs<br>dpsvs <sub>c</sub>                   | Response pressure safety valve system<br>Closing pressure tolerance of the safety valve                   |
|            |  | EN 12828                                   | <b>pe ≤ psvs - dpsvs<sub>c</sub></b>              | dpsvs <sub>c</sub> =<br>dpsvs <sub>c</sub> = | 0,5 bar for psvs ≤ 5 bar <sup>4)</sup><br>0,1 · psvs for psvs > 5 bar <sup>4)</sup>                       |
|            |  | Cooling                                    | <b>pe ≤ psvs - dpsvs<sub>c</sub></b>              | dpsvs <sub>c</sub> =<br>dpsvs <sub>c</sub> = | 0,6 bar for psvs ≤ 3 bar <sup>4)</sup><br>0,2 · psvs for psvs > 3 bar <sup>4)</sup>                       |
|            |  | SWKI HE301-01 heating                      | <b>pe ≤ psvs/1,15 and<br/>pe ≤ psvs - 0,3 bar</b> |  | psvs <sup>4)</sup>  |
|            |  | SWKI HE301-01 cooling,<br>solar, heat pump | <b>pe ≤ psvs/1,3 and<br/>pe ≤ psvs - 0,6 bar</b>  |  | psvs <sup>4)</sup>  |

#### Transfero

|               |  |                      |                              |  |
|---------------|--|----------------------|------------------------------|--|
| <b>pe</b>     | Final pressure<br>Upper threshold for an optimum pressure maintenance. | <b>pe = pa + 0,4</b> |                              |  |
| <b>VN</b>     | Nominal volume of the expansion vessel <sup>5)</sup>                   | EN 12828,<br>cooling | <b>VN ≥ (Ve + Vwr) · 1,1</b> |  |
|               |  | SWKI HE301-01        | <b>VN ≥ Ve · 1,1</b>         |  |
| <b>TecBox</b> |  | <b>Q = f(Hst)</b>    | >> Quick selection Transfero |  |

- 1) Heating, Cooling, Solar:  $Q \leq 10 \text{ kW}: X = 3 | 10 \text{ kW} < Q \leq 150 \text{ kW}: X = (87-0,3 \cdot Q)/28 | Q > 150 \text{ kW}: X = 1,5$   
Geothermal probe systems:  $X = 2,5$
- 2) The formula for minimum pressure p0 applies to the installation of the pressure maintenance on the suction side of the circulation pump. In case of a pressure-side installation p0 is to be increased by the pump pressure  $\Delta p$ .
- 4) The safety valves must operate within these limits. Use component tested and certified safety valves of type H and DGH for heating systems, type F and DGF for cooling systems. For systems according to SWKI HE301-01, only safety valves of the approval type DGF and DGH are to be used.
- 5) Please select a vessel which has an equal or higher nominal content.
- 7) Max. system standstill temperature, usually 40°C for cooling applications and geothermal probes with ground regeneration, 20°C for other geothermal probes
- \*) SWKI HE301-01: Valid for Switzerland

HySelect calculation software is based on an advanced calculation method and database. Results may vary.

**Table 1: e expansion coefficient**

| t (TAZ, ts <sub>max</sub> , tr, ts <sub>min</sub> ), °C | 20     | 30     | 40     | 50     | 60     | 70     | 80     | 90     | 100    | 105    | 110    |
|---|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| e Water = 0 °C  | 0,0016 | 0,0041 | 0,0077 | 0,0119 | 0,0169 | 0,0226 | 0,0288 | 0,0357 | 0,0433 | 0,0472 | 0,0513 |
| <b>e % weight MEG*</b>                                  |        |        |        |        |        |        |        |        |        |        |        |
| 30 % = -14,5 °C   | 0,0093 | 0,0129 | 0,0169 | 0,0224 | 0,0286 | 0,0352 | 0,0422 | 0,0497 | 0,0577 | 0,0620 | 0,0663 |
| 40 % = -23,9 °C   | 0,0144 | 0,0189 | 0,0240 | 0,0300 | 0,0363 | 0,0432 | 0,0505 | 0,0582 | 0,0663 | 0,0706 | 0,0750 |
| 50 % = -35,6 °C   | 0,0198 | 0,0251 | 0,0307 | 0,0370 | 0,0437 | 0,0507 | 0,0581 | 0,0660 | 0,0742 | 0,0786 | 0,0830 |
| <b>e % weight MPG**</b>                                 |        |        |        |        |        |        |        |        |        |        |        |
| 30 % = -12,9 °C   | 0,0151 | 0,0207 | 0,0267 | 0,0333 | 0,0401 | 0,0476 | 0,0554 | 0,0639 | 0,0727 | 0,0774 | 0,0823 |
| 40 % = -20,9 °C   | 0,0211 | 0,0272 | 0,0338 | 0,0408 | 0,0481 | 0,0561 | 0,0644 | 0,0731 | 0,0826 | 0,0873 | 0,0924 |
| 50 % = -33,2 °C   | 0,0288 | 0,0355 | 0,0425 | 0,0500 | 0,0577 | 0,0660 | 0,0747 | 0,0839 | 0,0935 | 0,0985 | 0,1036 |

**Table 4: vs approx. water capacity \*\*\* of central heatings referred to the installed heat capacity Q**

| ts <sub>max</sub>   tr | °C          | 90   70 | 80   60 | 70   55 | 70   50 | 60   40 | 50   40 | 40   30 | 35   28 |
|------------------------|-------------|---------|---------|---------|---------|---------|---------|---------|---------|
| Radiators              | vs liter/kW | 14,0    | 16,5    | 20,1    | 20,6    | 27,9    | 36,6    | -       | -       |
| Flat radiators         | vs liter/kW | 9,0     | 10,1    | 12,1    | 11,9    | 15,1    | 20,1    | -       | -       |
| Convector              | vs liter/kW | 6,5     | 7,0     | 8,4     | 7,9     | 9,6     | 13,4    | -       | -       |
| Air handlers           | vs liter/kW | 5,8     | 6,1     | 7,2     | 6,6     | 7,6     | 10,8    | -       | -       |
| Floor heating          | vs liter/kW | 10,3    | 11,4    | 13,3    | 13,1    | 15,8    | 20,3    | 29,1    | 37,8    |

\*) MEG = Mono-Ethylene Glycol

\*\*) MPG = Mono-Propylene Glycol

\*\*\*) Water capacity = heat generator + distribution net + heat emitters

**Table 6: DNe standard values for expansion pipes with Transfero TVI\_\***

|                           |            | TVI_19.1 EH   | TVI_19.2 EH   | TVI_25.1 EH   | TVI_25.2 EH   |
|---------------------------|------------|---------------|---------------|---------------|---------------|
| Length up to approx. 5 m  | <b>DNe</b> | 32            | 50/40         | 32            | 50/40         |
|                           | Hst   m    | all           | <128 / ≥ 128  | all           | < 182 / ≥ 182 |
|                           | <b>DNd</b> | 25            | 25            | 25            | 25            |
|                           | Hst   m    | all           | all           | all           | all           |
| Length up to approx. 10 m | <b>DNe</b> | 40/32         | 65/50         | 40/32         | 65/50         |
|                           | Hst   m    | < 88 / ≥ 88   | < 87 / ≥ 87   | < 136 / ≥ 136 | < 136 / ≥ 136 |
|                           | <b>DNd</b> | 25            | 25            | 25            | 25            |
|                           | Hst   m    | all           | all           | all           | all           |
| Length up to approx. 30 m | <b>DNe</b> | 50/40         | 65/50         | 50/40         | 65/50         |
|                           | Hst   m    | < 101 / ≥ 101 | < 134 / ≥ 134 | < 150 / ≥ 150 | < 188 / ≥ 188 |
|                           | <b>DNd</b> | 32            | 32            | 32            | 32            |
|                           | Hst   m    | all           | all           | all           | all           |

\*)


For proper operation of the devices, the specified DNe values cannot fall below.

TVI.1 EH, TVI.2 EH for tr &lt; 5 °C or tr &gt; 70 °C: 2 expansion pipes DNe, 1 connection pipe DNd due to degassing

TVI.1 EH, TVI.2 EH for 5 °C ≤ tr ≤ 70 °C: 1 expansion pipes DNe, 1 connection pipe DNd due to degassing

## Temperatures


|                   |   |   |
|-------------------|---|---|
| ts <sub>max</sub> | <b>Maximum system temperature</b>   | Maximum temperature for the calculation of the volume expansion. For heating systems the dimensioned flow temperature at which a heating system is to be operated with the lowest outside temperature to be assumed (standard outside temperature according to EN 12828). For cooling systems the max. temperature that is achieved due to the operation mode or standstill, for solar systems the temperature up to which an evaporation is to be avoided. |
| ts <sub>min</sub> | <b>Lowest system temperature</b>  | Lowest temperature for calculating expansion volumes. The lowest system temperature is equal to the freezing point. It is dependant on the percentage of antifreeze additives. For water without additives ts <sub>min</sub> = 0.   |
| tr                | <b>Return temperature</b>   | Return temperature of the heating system with the lowest outside temperature to be assumed (standard outside temperature according to EN 12828).  |
| TAZ               | <b>Safety temperature limiter   Safety temperature controller   Temperature limit</b> | Safety device according to EN 12828 for the temperature protection of heat generators. If the set temperature limit is exceeded the heating is turned off. Limiters are locked, controllers automatically release the heat supply if the set temperature falls short. Setting value for systems according to EN 12828 ≤ 110 °C.   |

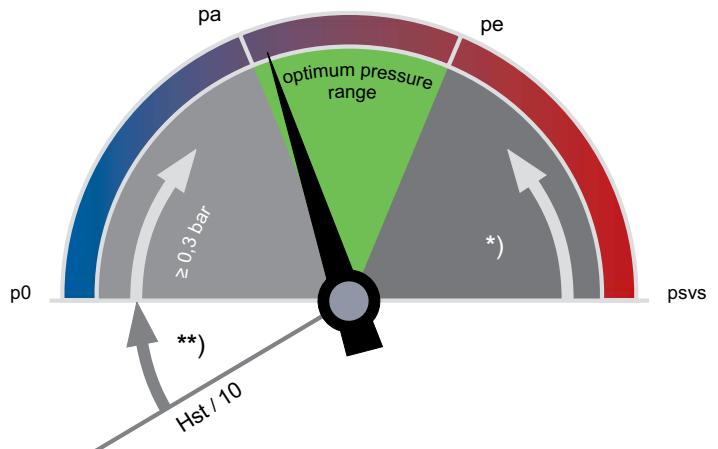**Precision pressure maintenance**Transfero minimizes the pressure variations between  $p_a$  and  $p_e$ .Transfero  $\pm 0,2$  bar


\*\*)

EN 12828, Solar, Cooling:  $\geq 0,2$  barSWKI HE301-0:  $\geq 0,3$  bar


\*)

EN 12828:  $\geq p_{svs} \cdot 0,1 \geq 0,5$  barSolar, Cooling:  $\geq p_{svs} \cdot 0,2 \geq 0,6$  barSWKI HE301-01 Heating  $\geq p_{svs} \cdot (1-1/1,15) \geq 0,3$  barSWKI HE301-01 Cooling, Solar, Heat Pumps  $\geq p_{svs} \cdot (1-1/1,3) \geq 0,6$  bar**p0 Minimum pressure****Transfero**

p0 and the switching points are calculated by the BrainCube.

**pa Initial pressure****Transfero**If the system pressure is  $< p_a$ , the pump starts.


$$p_a = p_0 + 0,3$$

**pe Final pressure****Transfero**If system pressure is  $> p_e$ , the relief valve opens.

$$p_e = p_a + 0,4$$

**Quick selection**

Operation range dpu

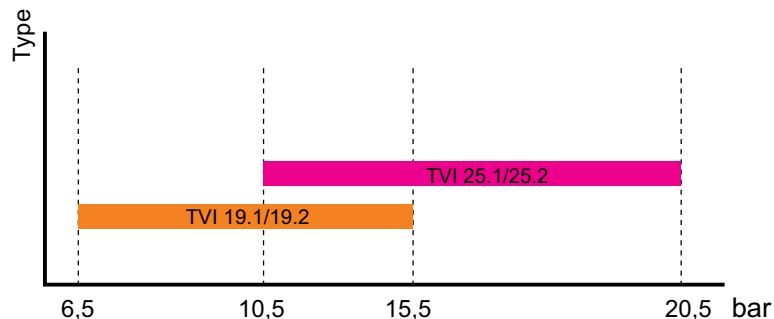**dpu****TVI\_19      TVI\_25**

| dpu min | bar | 6,5  | 10,5 |
|---------|-----|------|------|
| dpu max | bar | 15,5 | 20,5 |



## Quick selection

**Heating systems TAZ ≤ 100°C, without addition of antifreeze, EN 12828, SWKI HE301-01.**

For exact calculations please use HySelect software.

| Q [kW]                   | TecBox                   |             |                      |             | Primary vessel            |         |                |         |
|--------------------------|--------------------------|-------------|----------------------|-------------|---------------------------|---------|----------------|---------|
|                          | 1 pump, high flow        |             | 2 pumps *, high flow |             | Radiators                 |         | Flat radiators |         |
|                          | TVI 19.1 EH              | TVI 25.1 EH | TVI 19.2 EH          | TVI 25.5 EH | 90   70                   | 70   50 | 90   70        | 70   50 |
| Static height Hst [m] ** | Static height Hst [m] ** |             |                      |             | Nominal volume VN [liter] |         |                |         |
|                          | min-max                  |             | min-max              |             |                           |         |                |         |
| <b>≤ 300</b>             | 58-149                   | 98-199      | 58-149               | 98-199      | 200                       | 200     | 200            | 200     |
| <b>400</b>               | 58-149                   | 98-199      | 58-149               | 98-199      | 300                       | 300     | 200            | 200     |
| <b>500</b>               | 58-149                   | 98-199      | 58-149               | 98-199      | 300                       | 300     | 200            | 200     |
| <b>600</b>               | 58-149                   | 98-199      | 58-149               | 98-199      | 400                       | 400     | 300            | 300     |
| <b>700</b>               | 58-149                   | 98-199      | 58-149               | 98-199      | 500                       | 500     | 300            | 300     |
| <b>800</b>               | 58-149                   | 98-199      | 58-149               | 98-199      | 500                       | 500     | 400            | 300     |
| <b>900</b>               | 58-149                   | 98-199      | 58-149               | 98-199      | 600                       | 600     | 400            | 400     |
| <b>1000</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 600                       | 600     | 400            | 400     |
| <b>1100</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 800                       | 800     | 500            | 500     |
| <b>1200</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 800                       | 800     | 500            | 500     |
| <b>1300</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 800                       | 800     | 500            | 500     |
| <b>1400</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1000                      | 1000    | 600            | 600     |
| <b>1500</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1000                      | 1000    | 600            | 600     |
| <b>1600</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1000                      | 1000    | 800            | 800     |
| <b>1700</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 800            | 800     |
| <b>1800</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 800            | 800     |
| <b>1900</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 800            | 800     |
| <b>2000</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 800            | 800     |
| <b>2100</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 1000           | 1000    |
| <b>2200</b>              | 58-149                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 1000           | 1000    |
| <b>2500</b>              | 58-147                   | 98-199      | 58-149               | 98-199      | 1500                      | 1500    | 1000           | 1000    |
| <b>3000</b>              | 58-132                   | 98-186      | 58-149               | 98-199      | 2000                      | 2000    | 1500           | 1500    |
| <b>3500</b>              | <b>58-115</b>            | 98-166      | 58-149               | 98-199      | 3000                      | 3000    | <b>1500</b>    | 1500    |
| <b>4000</b>              | 58-94                    | 98-143      | 58-149               | 98-199      | 3000                      | 3000    | 2000           | 2000    |
| <b>4500</b>              | 58-70                    | 98-117      | 58-149               | 98-199      | 3000                      | 3000    | 2000           | 2000    |
| <b>5000</b>              |                          |             | 58-144               | 98-199      | 3000                      | 3000    | 2000           | 2000    |
| <b>5500</b>              |                          |             | 58-137               | 98-192      | 4000                      | 4000    | 3000           | 3000    |
| <b>6000</b>              |                          |             | 58-128               | 98-183      | 4000                      | 4000    | 3000           | 3000    |
| <b>6500</b>              |                          |             | 58-119               | 98-173      | 4000                      | 4000    | 3000           | 3000    |
| <b>7000</b>              |                          |             | 58-109               | 98-162      | 5000                      | 5000    | 3000           | 3000    |
| <b>7500</b>              |                          |             | 58-98                | 98-149      | 5000                      | 5000    | 3000           | 3000    |
| <b>8000</b>              |                          |             | 58-86                | 98-136      | 5000                      | 5000    | 4000           | 4000    |

\*) 50% output per pump, full redundancy in the framed area.

\*\*) The value decreases with

TAZ = 105 °C by 2 m

TAZ = 110 °C by 4 m

SWKI HE301-01 by another 1m

### Example

Q = 3300 kW

Flat radiators 90 | 70 °C

TAZ = 105 °C

Hst = 110 m

psv = 16 bar

### Selected:

TecBox TVI 19.1 EH

Primary vessel TG 1500

### Setting of BrainCube:

Hst = 110 m

TAZ = 105 °C

### Check psv:

for TAZ = 105 °C

EN 12828 psv:  $(110/10 + 0,9 + 0,2) \cdot 1,11 = 12,32 \leq 16$  o.k.

SWKI HE301-01 psv:  $(110/10 + 1,0 + 0,2) \cdot 1,15 = 12,88 \leq 16$  o.k.

### Check Hst:

for TAZ = 105 °C

Hst:  $115 - 2 = 113 \geq 110$

### Transfero

= TecBox + Primary vessel + Extension vessel (optional)

### Extension vessel

The nominal volume can be allocated to multiple vessels of the same size.

**Setting values**

For TAZ, Hst and psv in the "Parameter" menu of the BrainCube.

|               |            | <b>TAZ = 100 °C</b>  | <b>TAZ = 105 °C</b>                         | <b>TAZ = 110 °C</b>                         |
|---------------|------------|----------------------|---|---|
| EN 12828      | Check psv: | for $psv \leq 5$ bar | $psv \geq 0,1 \cdot Hst + 1,4$              | $psv \geq 0,1 \cdot Hst + 1,6$              |
|               |            | for $psv > 5$ bar    | $psv \geq (0,1 \cdot Hst + 0,9) \cdot 1,11$ | $psv \geq (0,1 \cdot Hst + 1,1) \cdot 1,11$ |
| SWKI HE301-01 |            | for $psv \leq 3$ bar | $psv \geq (0,1 \cdot Hst + 1,0) \cdot 1,3$  | $psv \geq (0,1 \cdot Hst + 1,2) \cdot 1,3$  |
|               |            | for $psv > 3$ bar    | $psv \geq (0,1 \cdot Hst + 1,0) \cdot 1,15$ | $psv \geq (0,1 \cdot Hst + 1,2) \cdot 1,15$ |

The BrainCube determines the switching points and the minimum pressure p0.

**Equipment****Expansion pipes**

Transfero TVI\_: table 6

**Buffer vessels**

At least one Statico SH 150.25 is required for operation when system pressure  $p \leq 10$  bar, and one Statico SH 300.25 for operation when system pressure  $p > 10$  bar.

**Lock shield valve DLV**

for Statico SH 150/300 buffer vessels.

**Pleno**

Water make-up modules in combination with Transfero TVI Connect. Controlled via the BrainCube of the Transfero TecBox. Connected water softening units must have a minimum flow rate of 1300 l/h for direct connection. If the water treatment unit has a lower flow rate a flow limiter in the inlet of the water meter must be used (a 240 l/h flow limiter is enclosed with the Transfero).

**Pleno Refill**

Water softening and demineralization modules in combination with Transfero TVI Connect. Controlled via the BrainCube of the Transfero TecBox.

**Intermediate vessel**


An intermediate vessel is required for return temperatures higher than 70°C respectively lower than 5°C.

**Zeparo**

Air vent Zeparo ZUT or ZUP at each high point for venting during the filling and during the draining process. Separator for sludge and magnetite in each system in the main return to the heat generator.

**Further accessories, product and selection details:**


Datasheets Pleno Refill, Zeparo and Accessories.

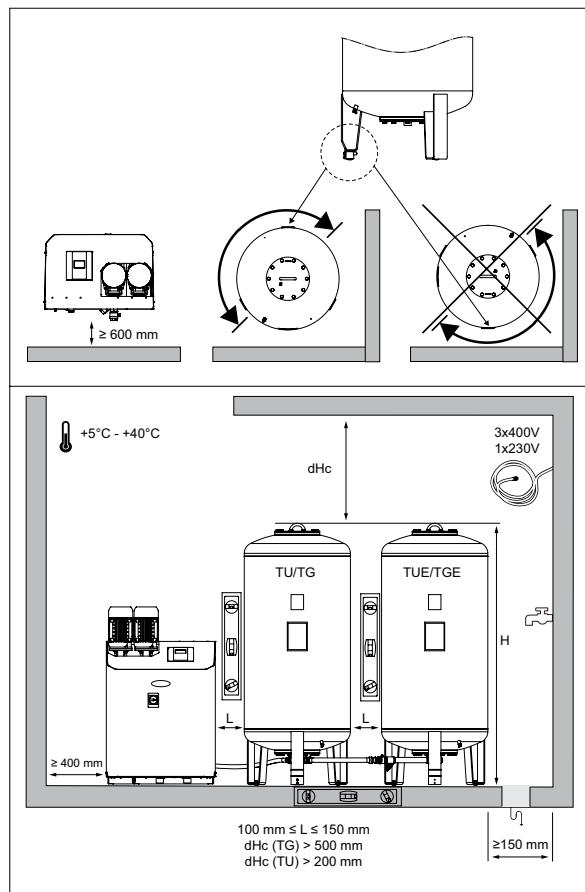**Installation**

## Principle scheme


### Transfero TVI.1 EH Connect

Grey area is optional

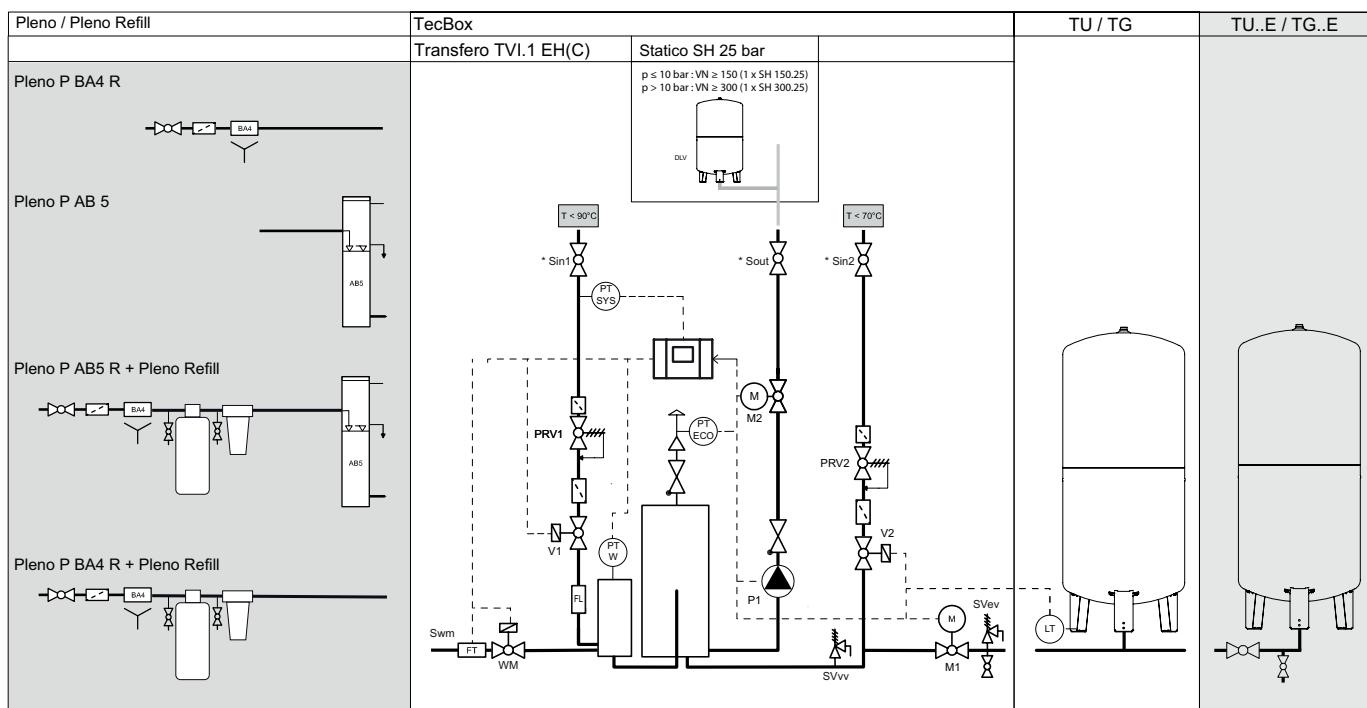

### Transfero TVI.2 EH Connect

Grey area is optional

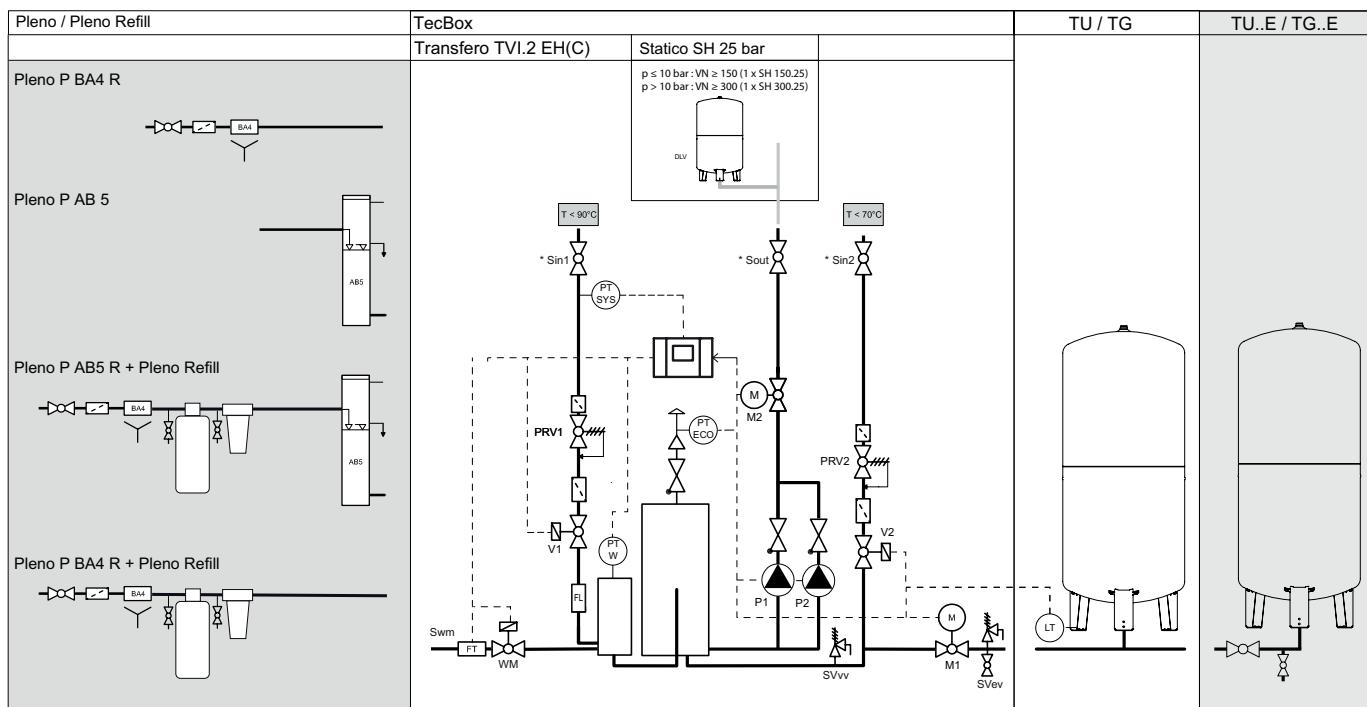

\* When connecting to rigid piping, it is essential to ensure that there is no axial, vertical or horizontal tension. The connections must not be loaded with any additional weights. Maximum tightening torques must be observed where specified. If tightening torques are not specified, the state of the art for the respective connection must be observed. A flexible connection is preferable to a rigid connection.


## Application examples

### Transfero TVI.1 EH Connect

TecBox with 1 pump, precision pressure maintenance  $\pm 0,2$  bar with cyclonic vacuum degassing, Pleno P BA4R for water make-up.

#### Example for heating systems, return temperature $tr \leq 70^\circ\text{C}$

(May require changes to meet local legislation)

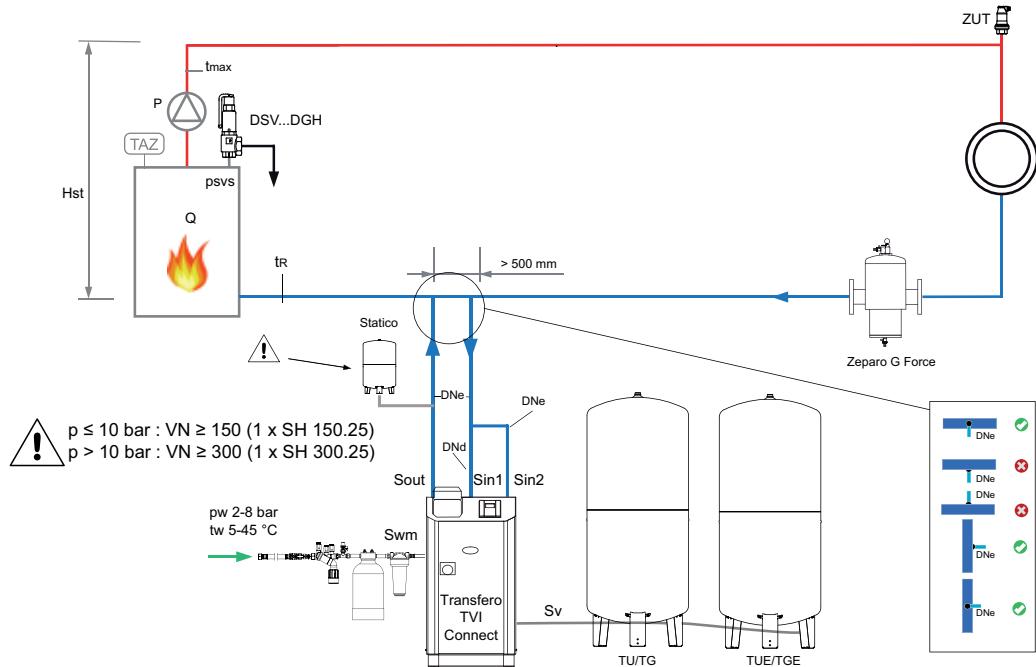


### Transfero TVI.2 EHC Connect

TecBox with 2 pumps, precision pressure maintenance  $\pm 0,2$  bar with cyclonic vacuum degassing. Pleno P AB5 for water make-up.

#### Example for cooling systems, return temperature $0^\circ\text{C} < tr \leq 5^\circ\text{C}$

(May require changes to meet local legislation)

Scheme is also valid for Transfero TVI.1 EHC

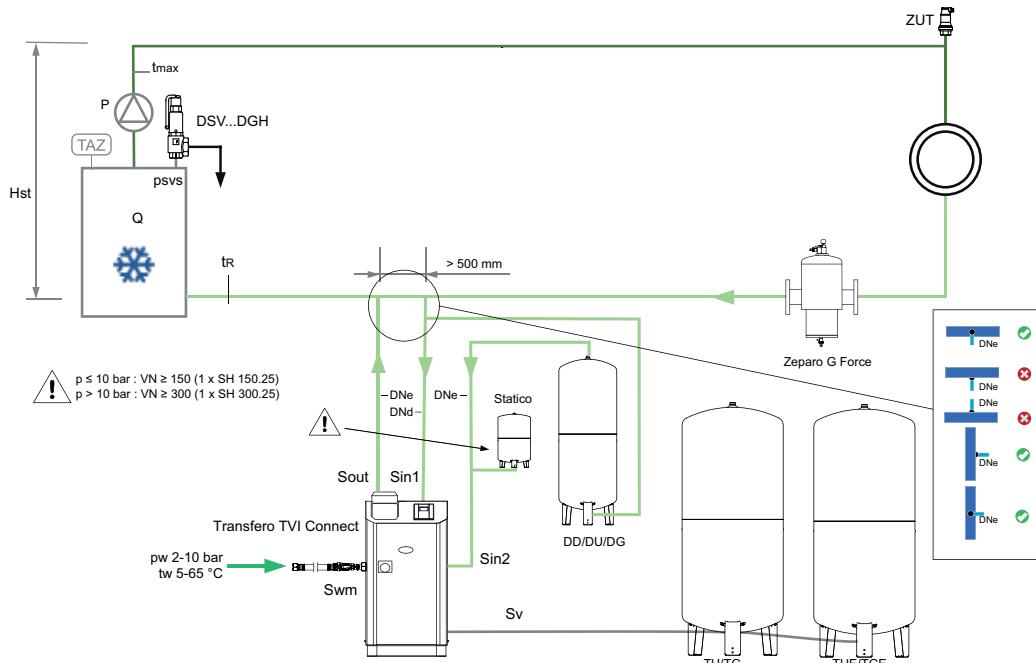

**Zeparo G-Force** for the central separation of sludge.

**Zeparo ZUT** for automatic venting during filling and during draining.

**Further accessories, product and selection details, see:** Datasheet Pleno Connect, Zeparo and Accessories.


### Transfero TVI.2 EH Connect

TecBox with 2 pumps, precision pressure maintenance  $\pm 0,2$  bar with cyclonic vacuum degassing, Pleno P AB5 R for the water make-up and Pleno Refill for water treatment.

### Example for heating systems, return temperature $tr \leq 70^\circ\text{C}$

(May require changes to meet local legislation)

Scheme is also valid for Transfero TVI.1 EH

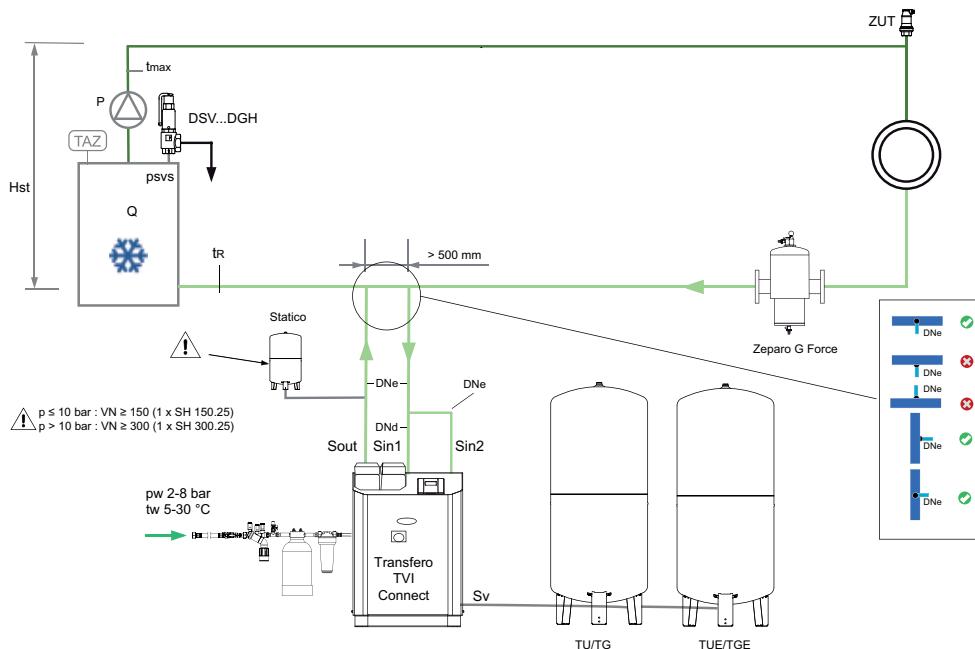


### Transfero TVI.2 EH Connect

TecBox with 2 pumps, precision pressure maintenance  $\pm 0,2$  bar with cyclonic vacuum degassing, Pleno P AB5 R for the water make-up and Pleno Refill for water treatment.

### Example for heating systems, return temperature $70^\circ\text{C} < tr \leq 90^\circ\text{C}$

(May require changes to meet local legislation)

Scheme is also valid for Transfero TVI.1 EH

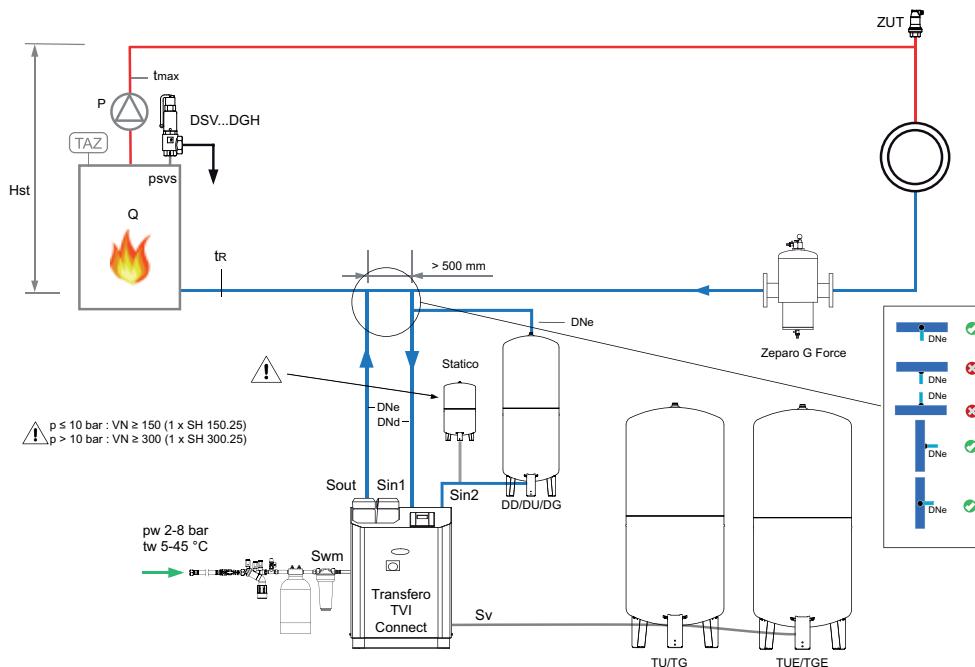


**Zeparo G-Force** for the central separation of sludge.

**Zeparo ZUT** for automatic venting during filling and during draining.

**Further accessories, product and selection details, see:** Datasheet Pleno Connect, Zeparo and Accessories.

## Control unit TecBox, Transfero TVI Connect Heating

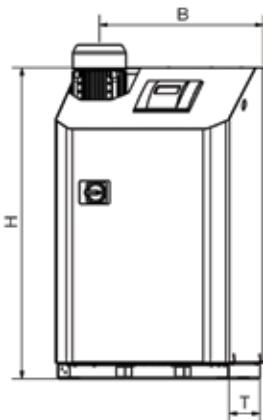


### Transfero TVI.1 EH Connect

Precision pressure maintenance  $\pm 0,2$  bar. 1 pump. 1 spill valve and two motor driven valves for degassing and pressurisation. 1 spill valve for peak load pressurisation.

1 solenoid valve and 1 water meter for water make-up.

| Type        | B   | H    | T   | m<br>[kg] | Pel<br>[kW] | dpu<br>[bar] | SPL<br>[dB(A)] | EAN           | Article No   |
|-------------|-----|------|-----|-----------|-------------|--------------|----------------|---------------|--------------|
| TVI 19.1 EH | 570 | 1086 | 601 | 85        | 2,6         | 6,5-15,5     | ~60*           | 7640161636767 | 301032-80600 |
| TVI 25.1 EH | 570 | 1258 | 601 | 94        | 3,4         | 10,5-20,5    | ~60*           | 7640161636712 | 301032-80700 |

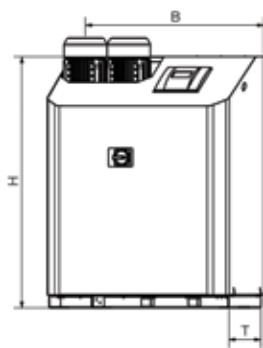

### Transfero TVI.2 EH Connect

Precision pressure maintenance  $\pm 0,2$  bar. 2 pumps. 1 spill valve and two motor driven valves for degassing and pressurisation. 1 spill valve for peak load pressurisation.

1 solenoid valve and 1 water meter for water make-up.

| Type        | B   | H    | T   | m<br>[kg] | Pel<br>[kW] | dpu<br>[bar] | SPL<br>[dB(A)] | EAN           | Article No   |
|-------------|-----|------|-----|-----------|-------------|--------------|----------------|---------------|--------------|
| TVI 19.2 EH | 751 | 1086 | 601 | 132       | 5,2         | 6,5-15,5     | ~60*           | 7640161636927 | 301032-90600 |
| TVI 25.2 EH | 751 | 1258 | 601 | 150       | 6,8         | 10,5-20,5    | ~60*           | 7640161636729 | 301032-90700 |


T = Depth of the device

dpu = Working pressure range

\*) Pump operation



## Control unit TecBox, Transfero TVI Connect Cooling

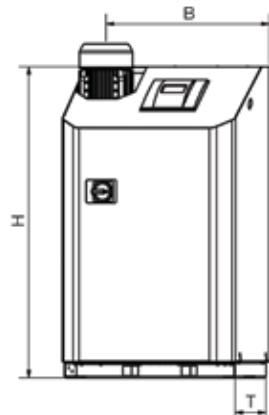


### Transfero TVI.1 EHC Connect

Precision pressure maintenance  $\pm 0,2$  bar. 1 pump. 1 spill valve and two motor driven valves for degassing and pressurisation. 1 spill valve for peak load pressurisation.

1 solenoid valve and 1 water meter for water make-up.

Cooling insulation with condensation water protection.

| Type         | B   | H    | T   | m<br>[kg] | Pel<br>[kW] | dpu<br>[bar] | SPL<br>[dB(A)] | EAN           | Article No   |
|--------------|-----|------|-----|-----------|-------------|--------------|----------------|---------------|--------------|
| TVI 19.1 EHC | 570 | 1086 | 601 | 87        | 2,6         | 6,5-15,5     | ~60*           | 7640161636736 | 301033-00600 |
| TVI 25.1 EHC | 570 | 1258 | 601 | 96        | 3,4         | 10,5-20,5    | ~60*           | 7640161636743 | 301033-00700 |

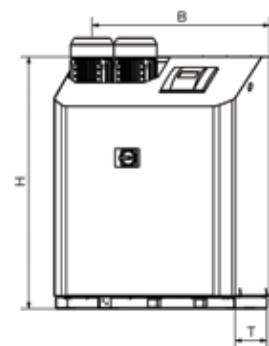

### Transfero TVI.2 EHC Connect

Precision pressure maintenance  $\pm 0,2$  bar. 2 pumps. 1 spill valve and two motor driven valves for degassing and pressurisation. 1 spill valve for peak load pressurisation.

1 solenoid valve and 1 water meter for water make-up.

Cooling insulation with condensation water protection.


| Type         | B   | H    | T   | m<br>[kg] | Pel<br>[kW] | dpu<br>[bar] | SPL<br>[dB(A)] | EAN           | Article No   |
|--------------|-----|------|-----|-----------|-------------|--------------|----------------|---------------|--------------|
| TVI 19.2 EHC | 751 | 1086 | 601 | 135       | 5,2         | 6,5-15,5     | ~60*           | 7640161636750 | 301033-10600 |
| TVI 25.2 EHC | 751 | 1258 | 601 | 153       | 6,8         | 10,5-20,5    | ~60*           | 7640161636934 | 301033-10700 |

T = Depth of the device

dpu = Working pressure range

\*) Pump operation


## Expansion vessels, Transfero TU/TU...E

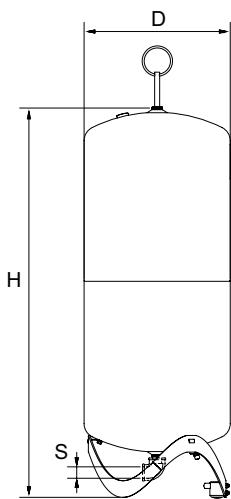

### Transfero TU

Primary vessel. Measuring foot for content measurement. Including assembly kit for the water-side connection.

| Type              | VN<br>[l] | D   | H    | H*** | m<br>[kg] | S        | EAN           | Article No |
|-------------------|-----------|-----|------|------|-----------|----------|---------------|------------|
| <b>2 bar (PS)</b> |           |     |      |      |           |          |               |            |
| TU 200            | 200       | 500 | 1339 | 1565 | 36        | Rp 1 1/4 | 7640148631594 | 713 1000   |
| TU 300            | 300       | 560 | 1469 | 1690 | 41        | Rp 1 1/4 | 7640148631600 | 713 1001   |
| TU 400            | 400       | 620 | 1532 | 1760 | 58        | Rp 1 1/4 | 7640148631617 | 713 1002   |
| TU 500            | 500       | 680 | 1627 | 1858 | 68        | Rp 1 1/4 | 7640148631624 | 713 1003   |
| TU 600            | 600       | 740 | 1638 | 1873 | 78        | Rp 1 1/4 | 7640148631631 | 713 1004   |
| TU 800            | 800       | 740 | 2132 | 2360 | 99        | Rp 1 1/4 | 7640148631648 | 713 1005   |

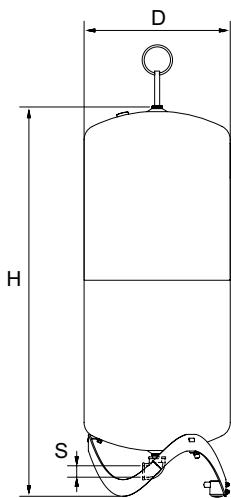

### Transfero TU...E

Secondary vessel.


Including assembly kit for the water-side connection, flexible hose and lock shield valve with ball valve for fast draining.

| Type              | VN<br>[l] | D   | H    | H*** | m<br>[kg] | S        | EAN           | Article No |
|-------------------|-----------|-----|------|------|-----------|----------|---------------|------------|
| <b>2 bar (PS)</b> |           |     |      |      |           |          |               |            |
| TU 200 E          | 200       | 500 | 1339 | 1565 | 35        | Rp 1 1/4 | 7640148631655 | 713 2000   |
| TU 300 E          | 300       | 560 | 1469 | 1690 | 40        | Rp 1 1/4 | 7640148631662 | 713 2001   |
| TU 400 E          | 400       | 620 | 1532 | 1760 | 57        | Rp 1 1/4 | 7640148631679 | 713 2002   |
| TU 500 E          | 500       | 680 | 1627 | 1868 | 67        | Rp 1 1/4 | 7640148631686 | 713 2003   |
| TU 600 E          | 600       | 740 | 1638 | 1873 | 75        | Rp 1 1/4 | 7640148631693 | 713 2004   |
| TU 800 E          | 800       | 740 | 2132 | 2360 | 98        | Rp 1 1/4 | 7640148631709 | 713 2005   |

VN = Nominal volume

\*\*\*) Max. height when vessel is tilted


## Expansion vessels, Transfero TG/TG...E

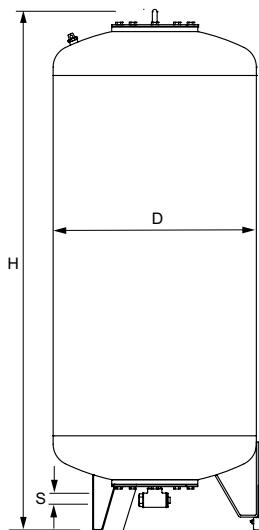

### Transfero TG

Primary vessel. Measuring foot for content measurement. Including assembly kit for the water-side connection.

| Type *            | VN<br>[l] | D    | H    | H*** | m<br>[kg] | S        | EAN           | Article No |
|-------------------|-----------|------|------|------|-----------|----------|---------------|------------|
| <b>2 bar (PS)</b> |           |      |      |      |           |          |               |            |
| TG 1000           | 1000      | 850  | 2199 | 2210 | 280       | Rp 1 1/4 | 7640148631716 | 713 1006   |
| TG 1500           | 1500      | 1016 | 2351 | 2381 | 360       | Rp 1 1/4 | 7640148631723 | 713 1007   |
| TG 2000           | 2000      | 1016 | 2848 | 2876 | 640       | Rp 1 1/4 | 7640148631730 | 713 1012   |
| TG 3000           | 3000      | 1300 | 2951 | 3016 | 800       | Rp 1 1/4 | 7640148631747 | 713 1009   |
| TG 4000           | 4000      | 1300 | 3592 | 3633 | 910       | Rp 1 1/4 | 7640148631754 | 713 1010   |
| TG 5000           | 5000      | 1300 | 4216 | 4275 | 1010      | Rp 1 1/4 | 7640148631761 | 713 1011   |

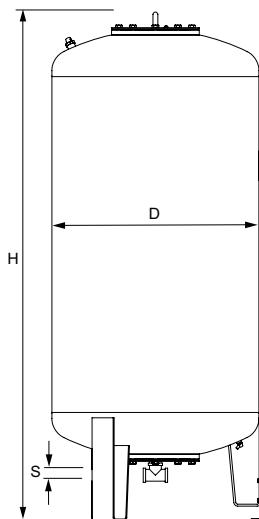

### Transfero TG...E

Secondary vessel.

Including flexible hose for the water-side connection and lock shield valve with ball valve for fast draining.

| Type *            | VN<br>[l] | D    | H    | H*** | m<br>[kg] | S        | Sw   | EAN           | Article No |
|-------------------|-----------|------|------|------|-----------|----------|------|---------------|------------|
| <b>2 bar (PS)</b> |           |      |      |      |           |          |      |               |            |
| TG 1000 E         | 1000      | 850  | 2199 | 2210 | 280       | Rp 1 1/4 | G3/4 | 7640148631778 | 713 2006   |
| TG 1500 E         | 1500      | 1016 | 2351 | 2381 | 360       | Rp 1 1/4 | G3/4 | 7640148631785 | 713 2007   |
| TG 2000 E         | 2000      | 1016 | 2848 | 2876 | 640       | Rp 1 1/4 | G3/4 | 7640148631792 | 713 2012   |
| TG 3000 E         | 3000      | 1300 | 2951 | 3016 | 800       | Rp 1 1/4 | G3/4 | 7640148631808 | 713 2009   |
| TG 4000 E         | 4000      | 1300 | 3592 | 3633 | 910       | Rp 1 1/4 | G3/4 | 7640148631815 | 713 2010   |
| TG 5000 E         | 5000      | 1300 | 4216 | 4275 | 1010      | Rp 1 1/4 | G3/4 | 7640148631822 | 713 2011   |


VN = Nominal volume

SW = Draining

\*) Special vessel upon request.

\*\*\*) Max. height when vessel is tilted. Tolerance 0 /-100.

## Lock shield valve for buffer vessel




### Lock shield valve DLV

Female thread on both sides, flat sealing union for direct connection to all suitable expansion vessels.

| Type   | PS<br>[bar] | L   | m<br>[kg] | S   | SG | SW   | EAN           | Article No |
|--------|-------------|-----|-----------|-----|----|------|---------------|------------|
| DLV 25 | 16          | 100 | 0,54      | Rp1 | G1 | G3/4 | 7640148638586 | 535 1436   |

\* for PS 25 applications use the IMI TA-BAV range for shut-off and drain valves.

## Buffer Vessel

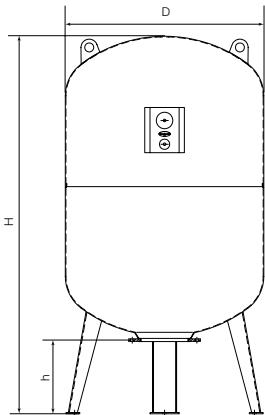

### Statico SH

Cylindrical shape


| Type                           | VN<br>[l] | p0<br>[bar] | D   | H    | m<br>[kg] | S      | EAN           | Article No   |
|--------------------------------|-----------|-------------|-----|------|-----------|--------|---------------|--------------|
| <b>25 bar (PS), 100°C (TS)</b> |           |             |     |      |           |        |               |              |
| SH 150.25                      | 150       | 4           | 500 | 1070 | 71        | R1 1/4 | 7640161636989 | 301012-01300 |
| SH 300.25                      | 300       | 4           | 640 | 1323 | 126       | R1 1/4 | 7640161637160 | 301012-01600 |

VN = Nominal volume

\*\*) Tolerance 0 /+35



## Pleno P water make-up modules



### Pleno P BA4 R

Hydraulic unit for water make-up operation with Vento/Transfero Connect, Pleno PX/PIX, Simply Compresso C 2.1-80 SWM, and in combination with Pleno Refill modules. Features a shut off valve, check valve, filter and a type BA backflow preventer (protection class 4) according to EN 1717. Connection (Swm): G1/2


| Type  | PS<br>[bar] | B   | L    | H   | m<br>[kg] | qwm<br>[l/h]    | EAN           | Article No |
|-------|-------------|-----|------|-----|-----------|-----------------|---------------|------------|
| BA4 R | 10          | 210 | 1300 | 135 | 1,1       | 350*            | 7640161630147 | 813 3310   |
|       |             |     |      |     |           | 250**           |               |            |
|       |             |     |      |     |           | 50***           |               |            |
|       |             |     |      |     |           | q(pw-pout) **** |               |            |

\* maximum average value for make-up water degassing with Vento V/VI and Transfero TV/TVI

\*\* maximum average value for make-up water degassing with Vento Compact

\*\*\* when using flow limiter for operation with low flow water treatment cartridges


\*\*\*\* for combination with Pleno PX/PIX see q(pw-pout) diagram in Pleno Connect datasheet

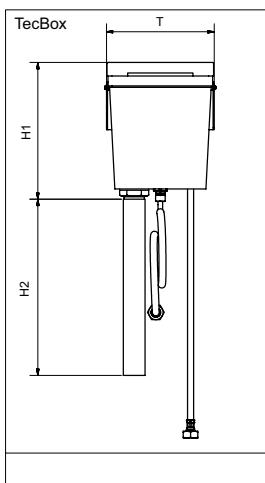

### Pleno P AB5

Hydraulic unit for water make up operation with Vento/Transfero Connect. Consists of a breaktank type AB (protection class 5) according EN 1717. For installation on the back of each unit. Can be used for 3rd party softening modules which do not fulfil the requirement of qwm min 1300 l/h and therefore cannot be directly connected.

| Type | PS<br>[bar] | T   | H1  | H2   | m<br>[kg] | qwm<br>[l/h] | EAN           | Article No |
|------|-------------|-----|-----|------|-----------|--------------|---------------|------------|
| AB5  | 10          | 220 | 280 | 1000 | 1,83      | 200          | 7640161630154 | 813 3320   |



### Pleno P AB5 R


Hydraulic unit for water make up operation with Vento/Transfero Connect. Consists of Pleno P BA4 R back flow preventer and Pleno P AB5 modules, with protection class 5 according to EN 1717.

| Type  | PS<br>[bar] | T   | H1  | H2   | m<br>[kg] | qwm<br>[l/h] | EAN           | Article No |
|-------|-------------|-----|-----|------|-----------|--------------|---------------|------------|
| AB5 R | 10          | 220 | 280 | 1000 | 3,8       | 200          | 7640161630161 | 813 3330   |

qwm = make-up water flow

T = Depth of the device

## Pleno Refill



### Pleno Refill

Hydraulic unit for water softening together with Vento/Transfero Connect TecBoxes. Filter with 25 µm mesh size to protect the hydronic system. Softening bottle filled with high grade resin.


3/4" swivelling nut, 3/4" external thread suitable for flat gasket.

Nominal pressure: PS 8

Max. working temperature: 45°C

Min. working temperature: > 4°C

| Type         | Capacity<br>l x °dH | S <sub>in</sub> | S <sub>out</sub> | D   | H   | L   | m<br>[kg] | EAN           | Article No |
|--------------|---------------------|-----------------|------------------|-----|-----|-----|-----------|---------------|------------|
| Refill 16000 | 16000               | G3/4            | G3/4             | 195 | 383 | 455 | 9,1       | 7640161630475 | 813 3210   |
| Refill 36000 | 36000               | G3/4            | G3/4             | 220 | 466 | 455 | 13        | 7640161630482 | 813 3220   |
| Refill 48000 | 48000               | G3/4            | G3/4             | 270 | 458 | 455 | 16,2      | 7640161630499 | 813 3230   |



### Pleno Refill Demin

Hydraulic unit for water demineralisation together with Vento/Transfero Connect TecBoxes. Filter with 25 µm mesh size to protect the hydronic system. Desalination bottle filled with high grade resin.

3/4" swivelling nut, 3/4" external thread suitable for flat gasket.

Nominal pressure: PS 8

Max. working temperature: 45°C

Min. working temperature: > 4°C

| Type               | Capacity<br>l x °dH | S <sub>in</sub> | S <sub>out</sub> | D   | H   | L   | m<br>[kg] | EAN           | Article No |
|--------------------|---------------------|-----------------|------------------|-----|-----|-----|-----------|---------------|------------|
| Refill Demin 13500 | 13500               | G3/4            | G3/4             | 220 | 466 | 455 | 13        | 7640161630505 | 813 3260   |
| Refill Demin 18000 | 18000               | G3/4            | G3/4             | 270 | 458 | 455 | 16,2      | 7640161630512 | 813 3270   |

#### Additional information:

**System design:** Datasheet *Planning and calculation*.


**Calculation:** Software HySelect

**Abbreviations and terminology:** Datasheet *Planning and calculation*.


**Further accessories, product and selection details, see:** Datasheet *Pleno, Zeparo and Accessories*.

## Wiring diagrams


### Power supply Transfero TVI at PowerCube PCI

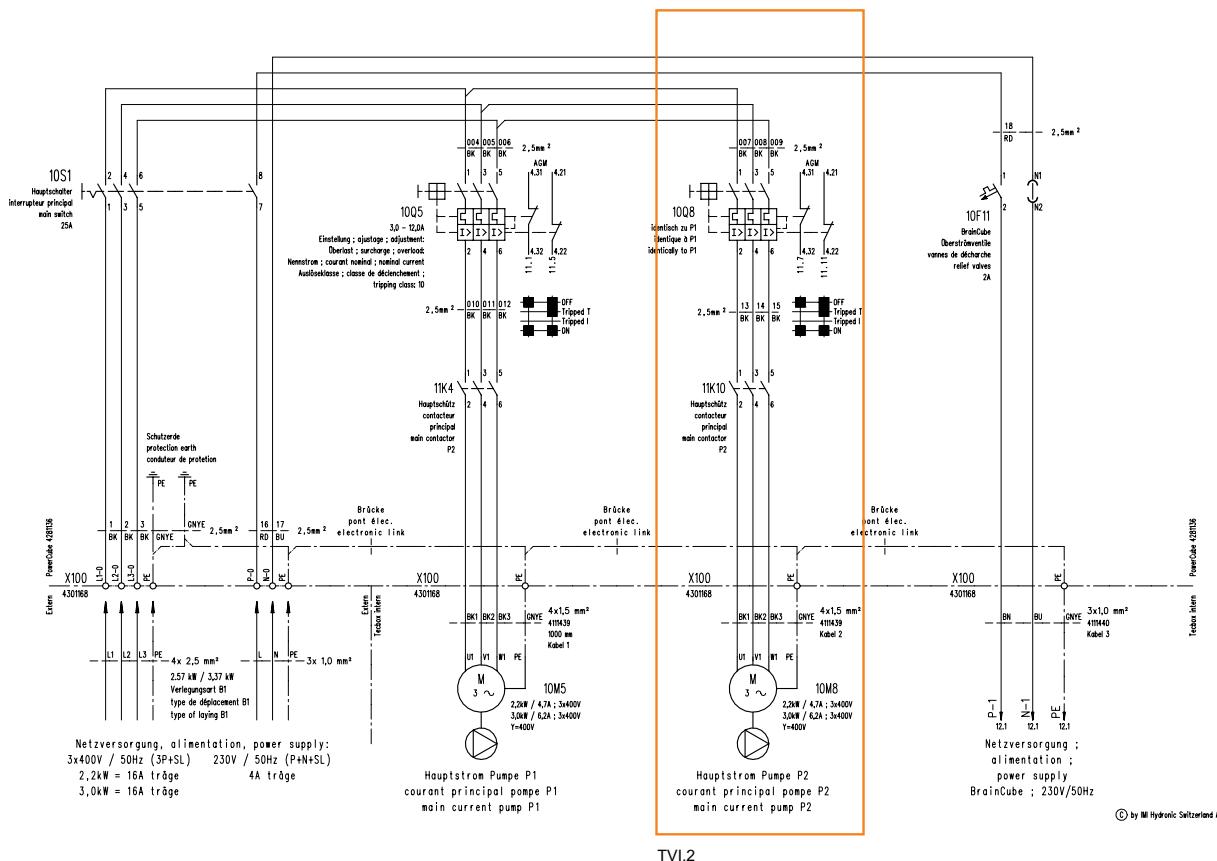


### 230V Section of the BrainCube

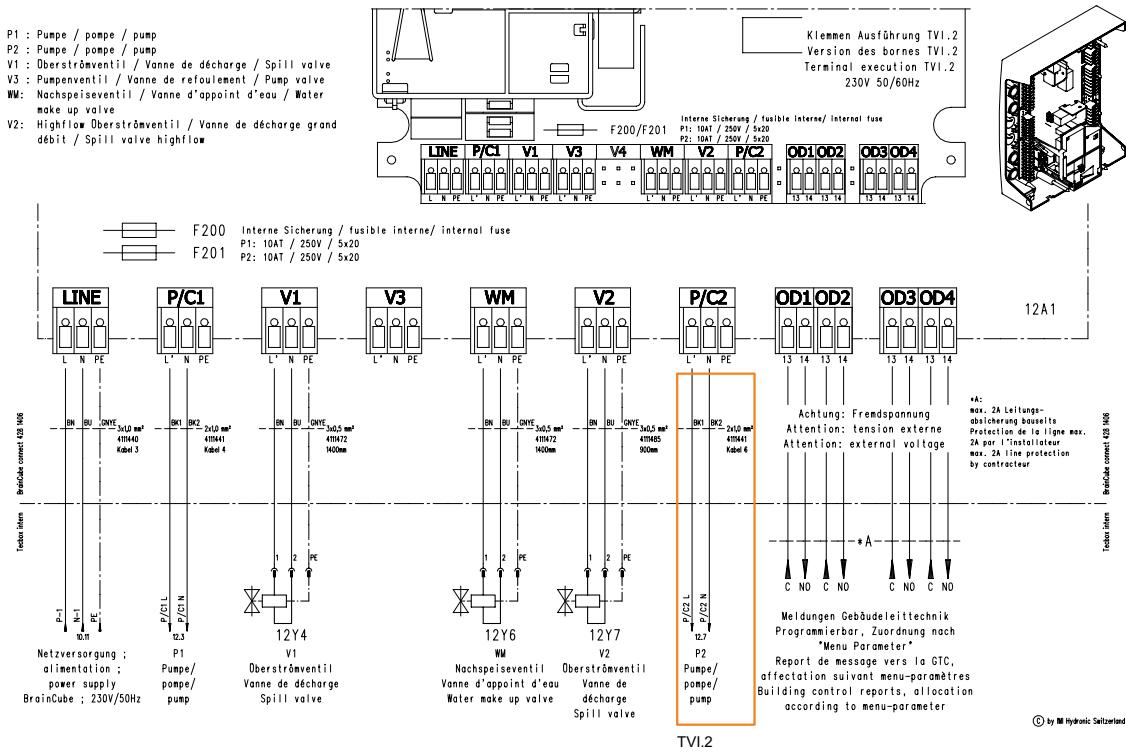

### Safety Extra Low Voltage connections at the BrainCube

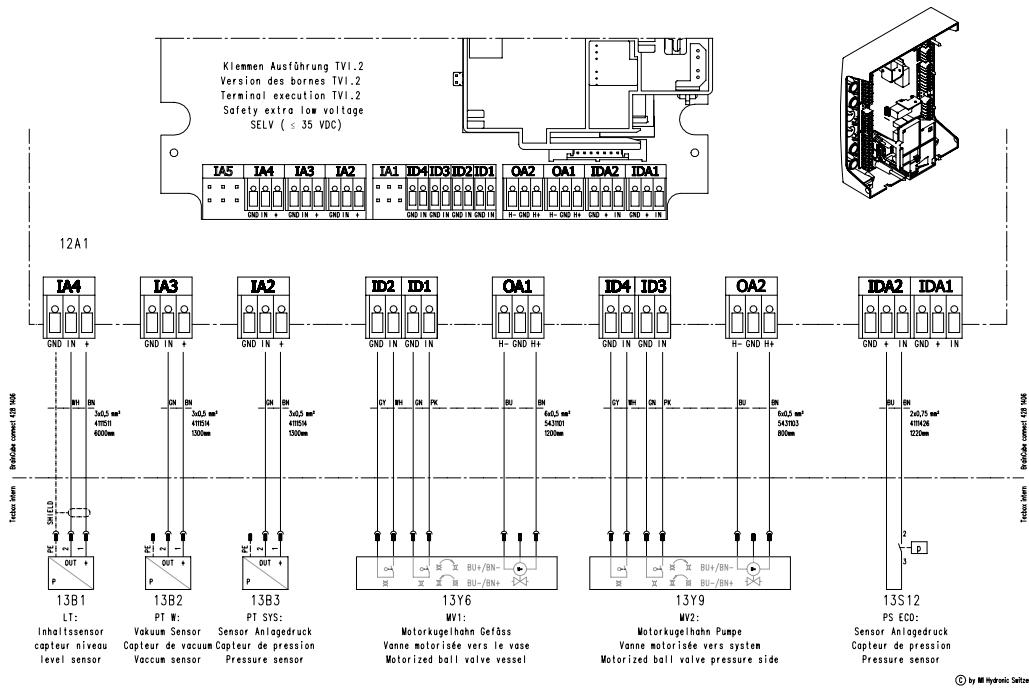

### Communication

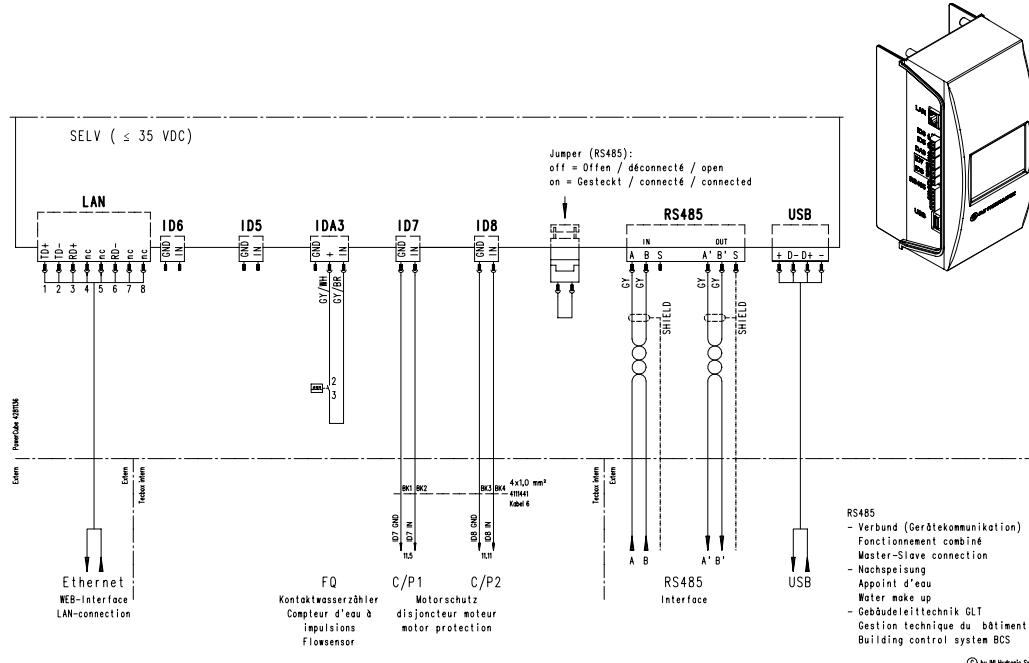

The products, texts, photographs, graphics and diagrams in this document may be subject to alteration by IMI Hydronic Engineering without prior notice or reasons being given. For the most up to date information about our products and specifications, please visit [www.imi-hydronic.com](http://www.imi-hydronic.com).