




Foam Systems | Multiple Foam Wet System - Pre-Piped (European)



These drawings are provided for guidance only and are not guaranteed to be up to date, accurate for every installation or to be compliant with local regulations.

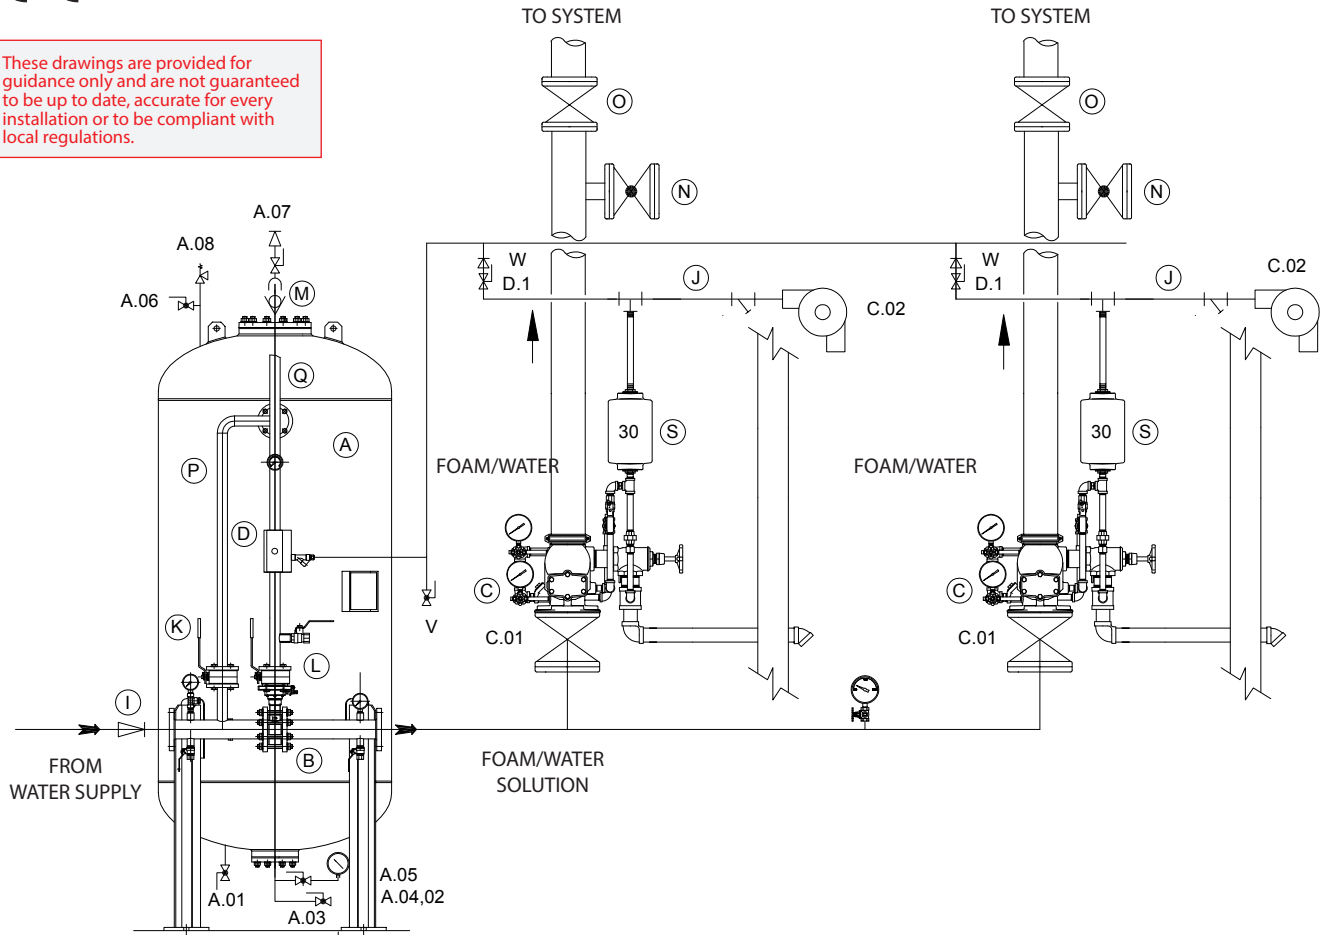

Pos.	Description	Pos.	Description
A	Foam concentrate bladder tank, including:	D	Hydraulic actuated valve (optional)
A.01	Water drain/Fill valve	D.1	Hydraulic actuated valve supply shut-off valve
A.02	Foam concentrate level drain	I	System check valve
A.03	Concentrate drain / fill valve	J	Alarm line piping
A.04	Foam level hydrometer valve	K	Bladder tank water supply control valve
A.05	Hydrometer (Foam concentrate gauge)	L	Foam concentrate control shut-off valve
A.06	Tank water vent valve	M	Foam concentrate swing check valve
A.07	Diaphragm concentrate vent valve	N	Foam solution test valve (optional)
A.08	Hydrostatic relief valve	O	System isolation valve (optional)
B	Wide range proportioner	P	Water supply piping to bladder tank
C	Alarm check valve model J-1 and trim	Q	Foam concentrate discharge piping
C.01	Water supply control valve	S	Retard chamber
C.02	Water motor alarm	V	Auxiliary valve (Hydraulic valve release) (optional)

Note: This document contains basic product information only. Information, photos and drawings are not contractually binding. In all cases, the manufacturer's full technical documentation (see "Related Documents" above) remains the reference document. Note that certificates, test reports and approvals may be published in the OEM name. The contents of this publication are subject to modifications without notice. All rights reserved

Trusted above all.

