




Foam Systems | Single Foam Deluge System - Riser Mounted

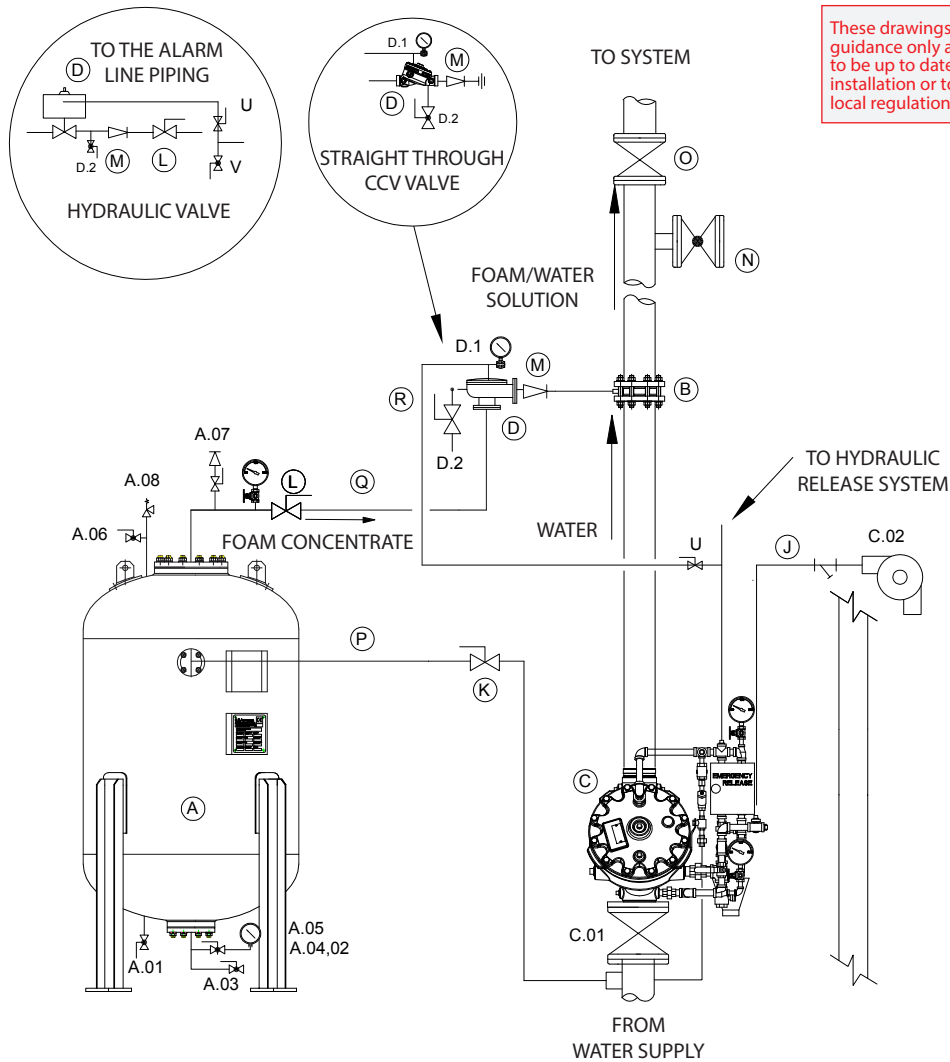

These drawings are provided for guidance only and are not guaranteed to be up to date, accurate for every installation or to be compliant with local regulations.

Pos.	Description	Pos.	Description
A	Foam concentrate bladder tank, including:	D	Foam concentrate control valve or hydraulic valve (optional)
A.01	Water drain/Fill valve	D.1	Water gauge
A.02	Foam concentrate level drain	D.2	Auxiliary drain valve
A.03	Concentrate drain / fill valve	J	Alarm line piping
A.04	Foam level hydrometer valve	K	Bladder tank water supply control valve
A.05	Hydrometer (Foam concentrate gauge)	L	Foam concentrate control shut-off valve
A.06	Tank water vent valve	M	Foam concentrate swing check valve
A.07	Diaphragm concentrate vent valve	N	Foam solution test valve (optional)
A.08	Hydrostatic relief valve	O	System isolation valve (optional)
B	Proportioning concentrate controller	P	Water supply piping to bladder tank
C	Deluge valve model E and conventional trim	Q	Foam concentrate discharge piping
C.01	Water supply control valve	R	Priming line 1/2"/DN15
C.02	Water motor alarm	U	Concentrate control valve priming / release isolation valve

Note: This document contains basic product information only. Information, photos and drawings are not contractually binding. In all cases, the manufacturer's full technical documentation (see "Related Documents" above) remains the reference document. Note that certificates, test reports and approvals may be published in the OEM name. The contents of this publication are subject to modifications without notice. All rights reserved

Trusted above all.

Viking S.A. (ed.) | 21, Z.I. Haneboesch | L-4562 Differdange/Nieder Korn | Luxembourg | vikinglux@viking-emea.com | www.viking-emea.com

