




## Foam Systems | Single Foam Deluge System - Pre-Piped

These drawings are provided for guidance only and are not guaranteed to be up to date, accurate for every installation or to be compliant with local regulations.

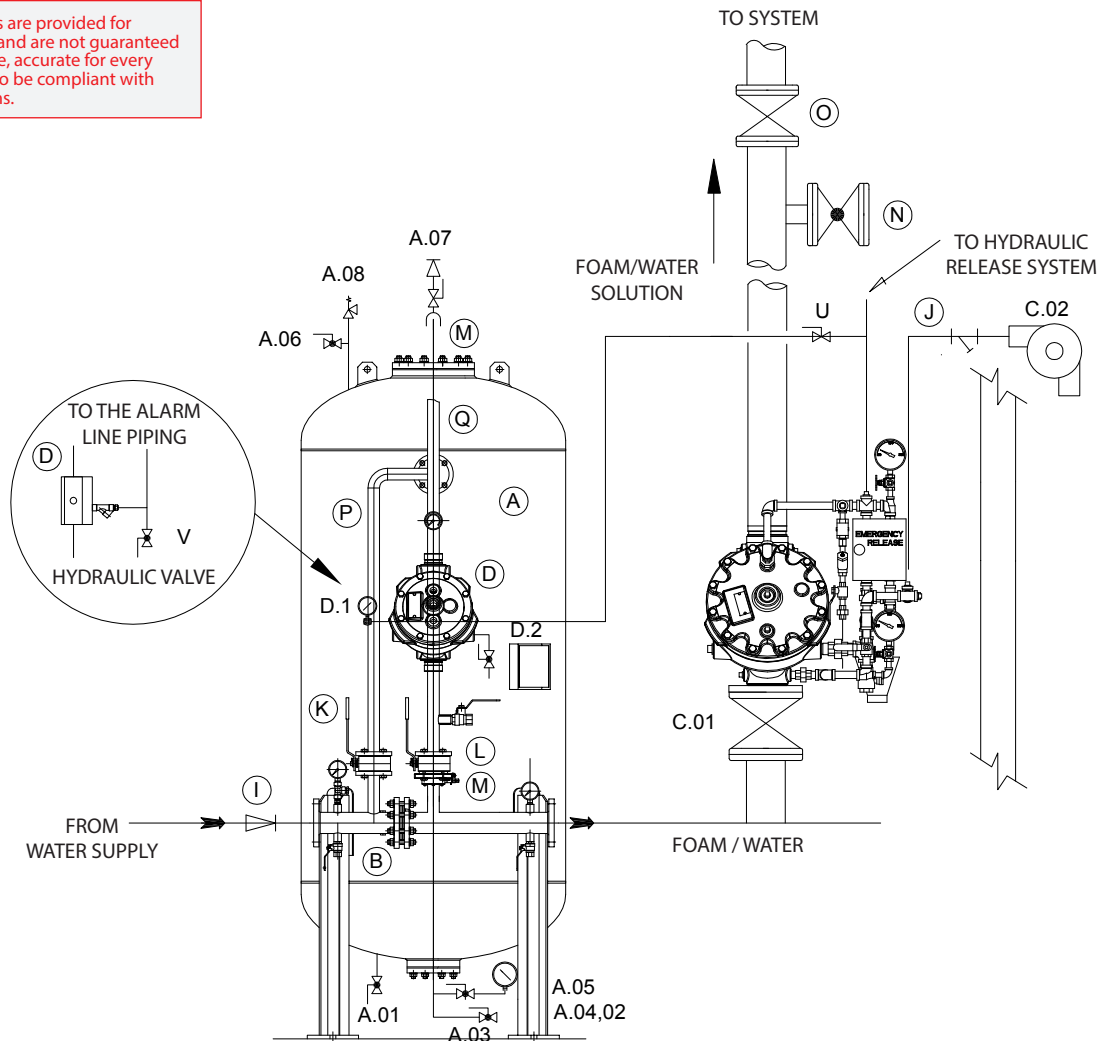

Pos.	Description	Pos.	Description
A	Foam concentrate bladder tank, including:	D	Foam concentrate control valve (Halar®) and trim (optional)
A.01	Water drain/Fill valve	D.1	Water gauge
A.02	Foam concentrate level drain	D.2	Auxiliary drain valve
A.03	Concentrate drain / fill valve	I	System check valve
A.04	Foam level hydrometer valve	J	Alarm line piping
A.05	Hydrometer (Foam concentrate gauge)	K	Bladder tank water supply control valve
A.06	Tank water vent valve	L	Foam concentrate control shut-off valve
A.07	Diaphragm concentrate vent valve	M	Foam concentrate swing check valve
A.08	Hydrostatic relief valve	N	Foam solution test valve (optional)
B	Proportioning concentrate controller	O	System isolation valve (optional)
C	Alarm check valve model J-1 and trim	P	Water supply piping to bladder tank
C.01	Water supply control valve	Q	Foam concentrate discharge piping
C.02	Water motor alarm	R	Priming line 1/2"/DN15
		U	Concentrate control valve priming / release isolation valve

Note: This document contains basic product information only. Information, photos and drawings are not contractually binding. In all cases, the manufacturer's full technical documentation (see "Related Documents" above) remains the reference document. Note that certificates, test reports and approvals may be published in the OEM name. The contents of this publication are subject to modifications without notice. All rights reserved

Trusted above all.

Viking S.A. (ed.) | 21, Z.I. Haneboesch | L-4562 Differdange/Nieder Korn | Luxembourg | vikinglux@viking-emea.com | www.viking-emea.com

